



NOTE TO CONTRACTOR:

- RESIDENTIAL DRIVEWAY TO BE 12' TO 24' IN WIDTH
- COMMERCIAL AND INDUSTRIAL DRIVEWAY TO BE A MAXIMUM OF 36' WIDE
- ALL CONCRETE SHALL BE 3000 PSI
- ELEV. "B" MINUS ELEV "A" EQUALS 1 INCH

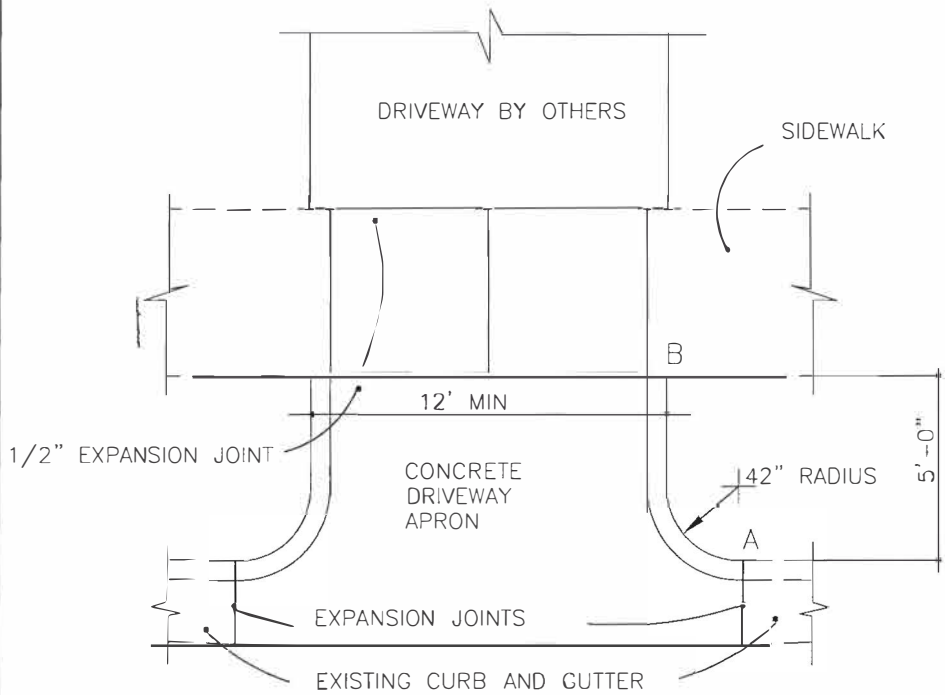

PLAN VIEW

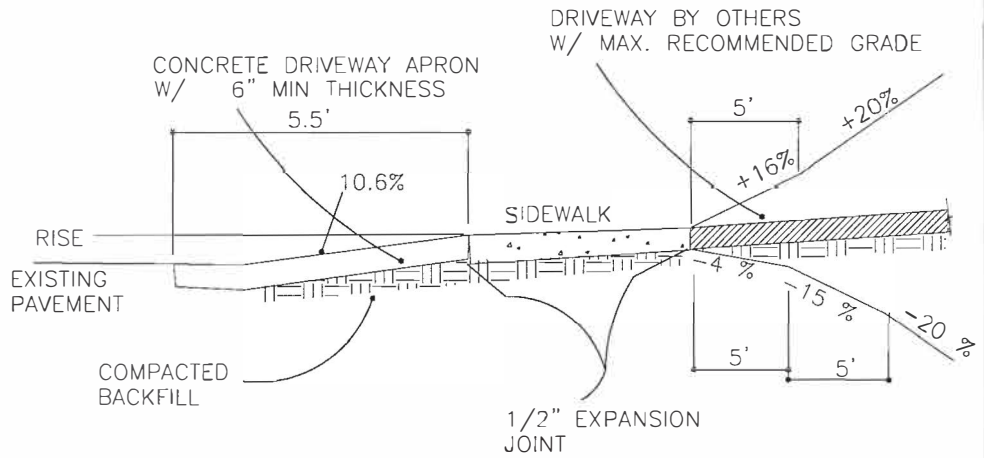

TYPICAL SECTION

NOTES:

1. CURB SHALL BE TAPERED TO FINISH FLUSH WITH SIDEWALK.
2. BEGINNING RADIUS SHALL NOT ENCROACH ON ADJACENT PROPERTIES BASED ON A PROJECTION OF THE PROPERTY LINE FROM THE RIGHT OF WAY TO THE CURB LINE.
3. SIDEWALK SECTION SHALL BE COMPLIED WITH WHEN SIDEWALKS ARE REQUIRED.

<p><b>SMITHFIELD</b> NORTH CAROLINA</p>	<p>STANDARD DETAIL AND SPECIFICATIONS MANUAL</p>
<p>Standard Driveway Apron</p>	<p>Drawing 0315</p>
<p>Date 1/12/2000</p>	